TELPU GRUPAS PLĀNA FRAGMENTS

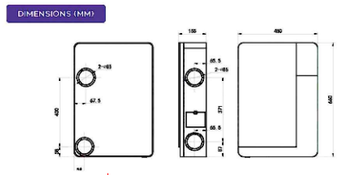

TELPU GRUPAS EKSPLIKĀCIJA
(Būves kadastra numurs 05000271303001)

NR.	NOSAUKUMS	PLATĪBA, m²
1264 - Ārstniecības vai veselības aprūpes iestāžu ēkas, ārstniecības vai veselības aprūpes iestāžu telpu grupa		
75	Tehniskā telpa	0,5
76	Gaitenis	35,4
78/79	Inventāra noliktava	26,4
81	Tehniskā telpa	0,6
83	Simulāciju aktīvā telpa	16,5
84-1	Apspriežu telpa	30,4
84-2	Vadības telpa	7,2
85	Mācību telpa	18,8
86	Gaitenis	31,4

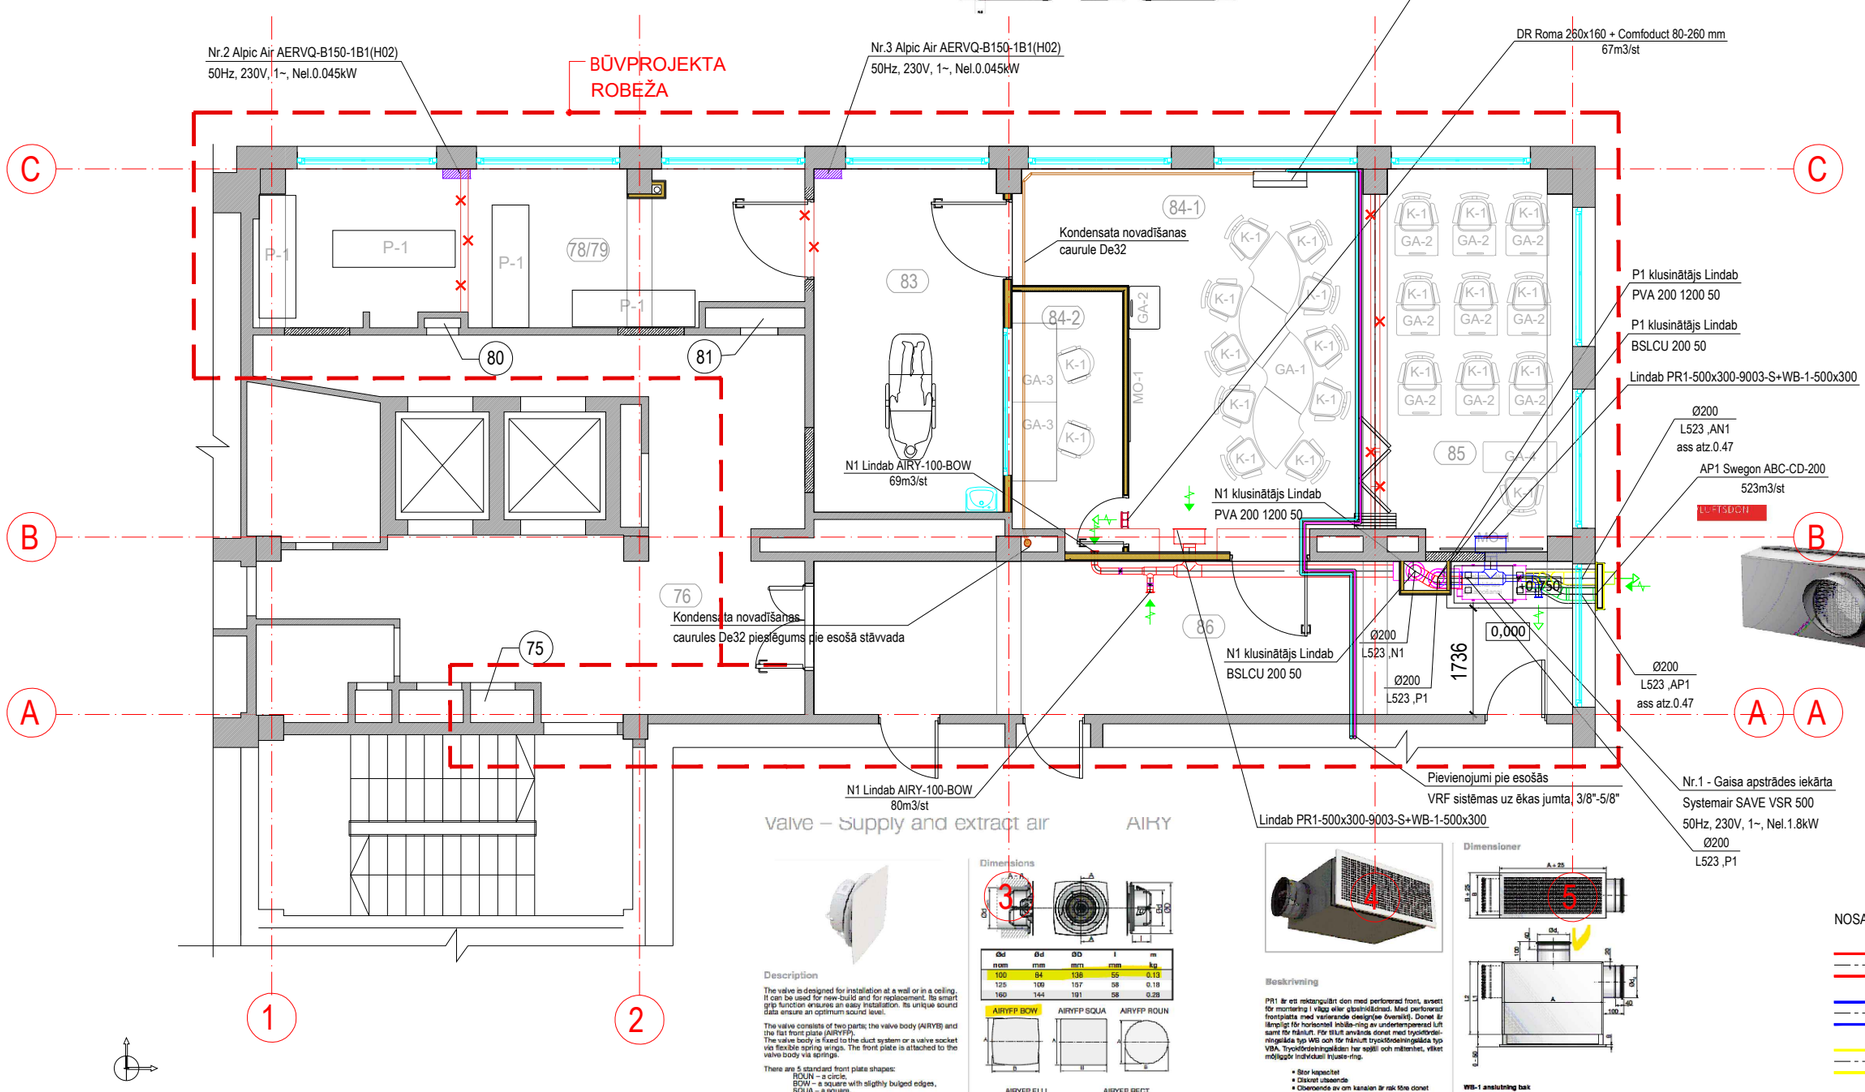

MĀTT

Storiek ABC-CD Zinkgrā	A mm	B mm	C mm	Ø D nippelmātt	CC mm
125	450	220	130	125	185
160	550	270	130	160	220
200	750	345	130	200	260
250	825	410	165	250	310
315	1000	490	200	315	420
400	1200	550	250	400	500
500	1400	720	300	500	600
630	2000	980	450	630	1120

Valve – Supply and extract air AIRY

Description

The valve is designed for installation at a wall or in a ceiling. It can be used for new-build and for replacement. Its smart grip function ensures an easy installation. Its unique sound data ensure an optimum sound level.

The valve consists of two parts; the valve body (AIRYB) and the flat front plate (AIRYFP).
The valve body is fixed to the duct system or a valve socket via flexible spring wings. The front plate is attached to the valve body via springs.

There are 5 standard front plate shapes:
ROUN – a circle,
BOW – a square with slightly bulged edges,
SQUA – a square,
ELLI – an super ellipse
RECT – a rectangle,
Special shapes are possible on request.

It is recommended that the valve is mounted in the frame ILVRU. The product will also fit in the valve frames VRGU, VRDM, VRFU, VRFM and the products BUCST, and TCFUCST.
The valve body has to cover the brim of the product it is fitted into. Therefor the maximum diameter of the brim for Ø100 is 133.5 mm, for Ø125 is 152.5 mm and for Ø160 is 187.5 mm.
Can be equipped with a blanking – off sector plate for 2 or 3 way air flow.

Maintenance

The visible parts can be wipad off with a damp cloth.
The sound filter should be cleaned or replaced when needed, this is especially of importance for extract air.

Order code

Product	AIRYB	ass	blb
AIRYB			
Connection dim. Ød (Ød mm = 100, 125, 160 mm			
Color (NAL 9003, RAL 9010)			

Dimensions

Ød nom	Ød mm	ØD mm	l mm	m kg
100	84	138	55	0.13
125	109	157	58	0.18
160	144	191	58	0.28

AIRYFP BOW AIRYFP SQUA AIRYFP ROUN

AIRYFP ELLI AIRYFP RECT

Ød nom	A mm	B mm	Type	m kg
100	140	140	BOW	0.17
100	140	210	ELLI	0.21
100	140	140	ROUN	0.13
100	140	210	RECT	0.24
100	140	140	SQUA	0.17
125	165	165	BOW	0.22
125	165	248	ELLI	0.29
125	165	165	ROUN	0.18
125	165	248	RECT	0.33
125	165	165	SQUA	0.23
160	210	210	BOW	0.34
160	210	315	ELLI	0.44
160	210	210	ROUN	0.28
160	210	315	RECT	0.53
160	210	210	SQUA	0.35

Beskrivning

PR1 är ett rektangulärt don med perforerad front, avsett för montering i vägg eller glasinnerdörrad. Med perforerad frontplatta med vattenrande designdyke överskild. Donet är lämpligt för horisontell inblås-ning av undertemperarad luft samt för frånluft. För tilluft används donet med tryckfördelningslåda typ WB och för frånluft tryckfördelningslåda typ VBA. Tryckfördelningslådan har sopspil och mätenhet, vilket möjliggör individuell injuste-ring.

- Stor kapacitet
- Diskret utseende
- Doenende av om kanalen är rak från donet
- Tetniksfunktion i tryckfördelningslåda

Underhåll

Fronten kan demonteras och spjället tas ut för rengöring av invändiga delar eller för att komma åt kanalen. De synliga delarna av donet kan torkas av med en fuktig trasa.

Beställningsexempel

Dimensioner

WB-1 anslutning bak

A x B Storlek mm	Ød, mm	A mm	B mm	L1 mm	Vikt kg
300 – 100	80	300	100	240	2,60
400 – 160	100	400	160	240	3,50
500 – 160	125	500	160	240	4,30
600 – 200	160	600	200	240	6,60
600 – 300	200	600	300	240	7,40

NOSACĪTIE APZĪMĒJUMI:

- Nosūces gaisa vads N1
- Pieplūdes gaisa vads P1
- Gaisa izmešanas vads AN1
- Gaisa ņemšanas vads AP1

Fortum

LR Uzņēmuma reģ.Nr. 41503078964
Būvkomersanta reģ.Nr. 13877
Raiņa iela 28, Daugavpils, LV-5401
tālr.27707398, e-mail: sia.fortum@gmail.com

Amata nosaukums	Vārds, uzvārds	Paraksts	Datums
BPV:	Juris Jirgens		25.05.2026.
BPDV:	O.Zeltiņa-Lemberga		25.05.2026.
			25.05.2026.

BŪVNIECĪBAS IEROSINĀTĀJS / PASŪTĪTĀJS:
SIA "DAUGAVPILS REĢIONĀLĀ SLIMNĪCA"
Reģ. Nr. 41503029600

PROJEKTA NR.
26DRS

BŪVOBJEKTA NOSAUKUMS un ADRESE:
SIMULĀCIJU ISTABAS AR KLĪNISKAJIEM UZDEVUMIEM IZVEIDEI DAUGAVPILS REĢIONĀLAJĀ SLIMNĪCĀ VASARNĪCU IELĀ 20, DAUGAVPILS, LV-5417

RASĒJUMS:
Telpu grupas plāna fragments. Ventilācija

Stadija	Projekta sadaļa	Rasējuma Nr.	Lapas	Mērogs	Arhīva reģistrācijas Nr.
PR	AVK	AVK-04		1:100	